


FLOWCHART FOR HANDLING DEVIATING EQA-RESULT

Gunn B B Kristensen, Kristine Solem and Pål Rustad

NKK, Norsk Klinisk-kjemisk Kvalitetssikring

e-mail:gunn.kristensen@noklus.no

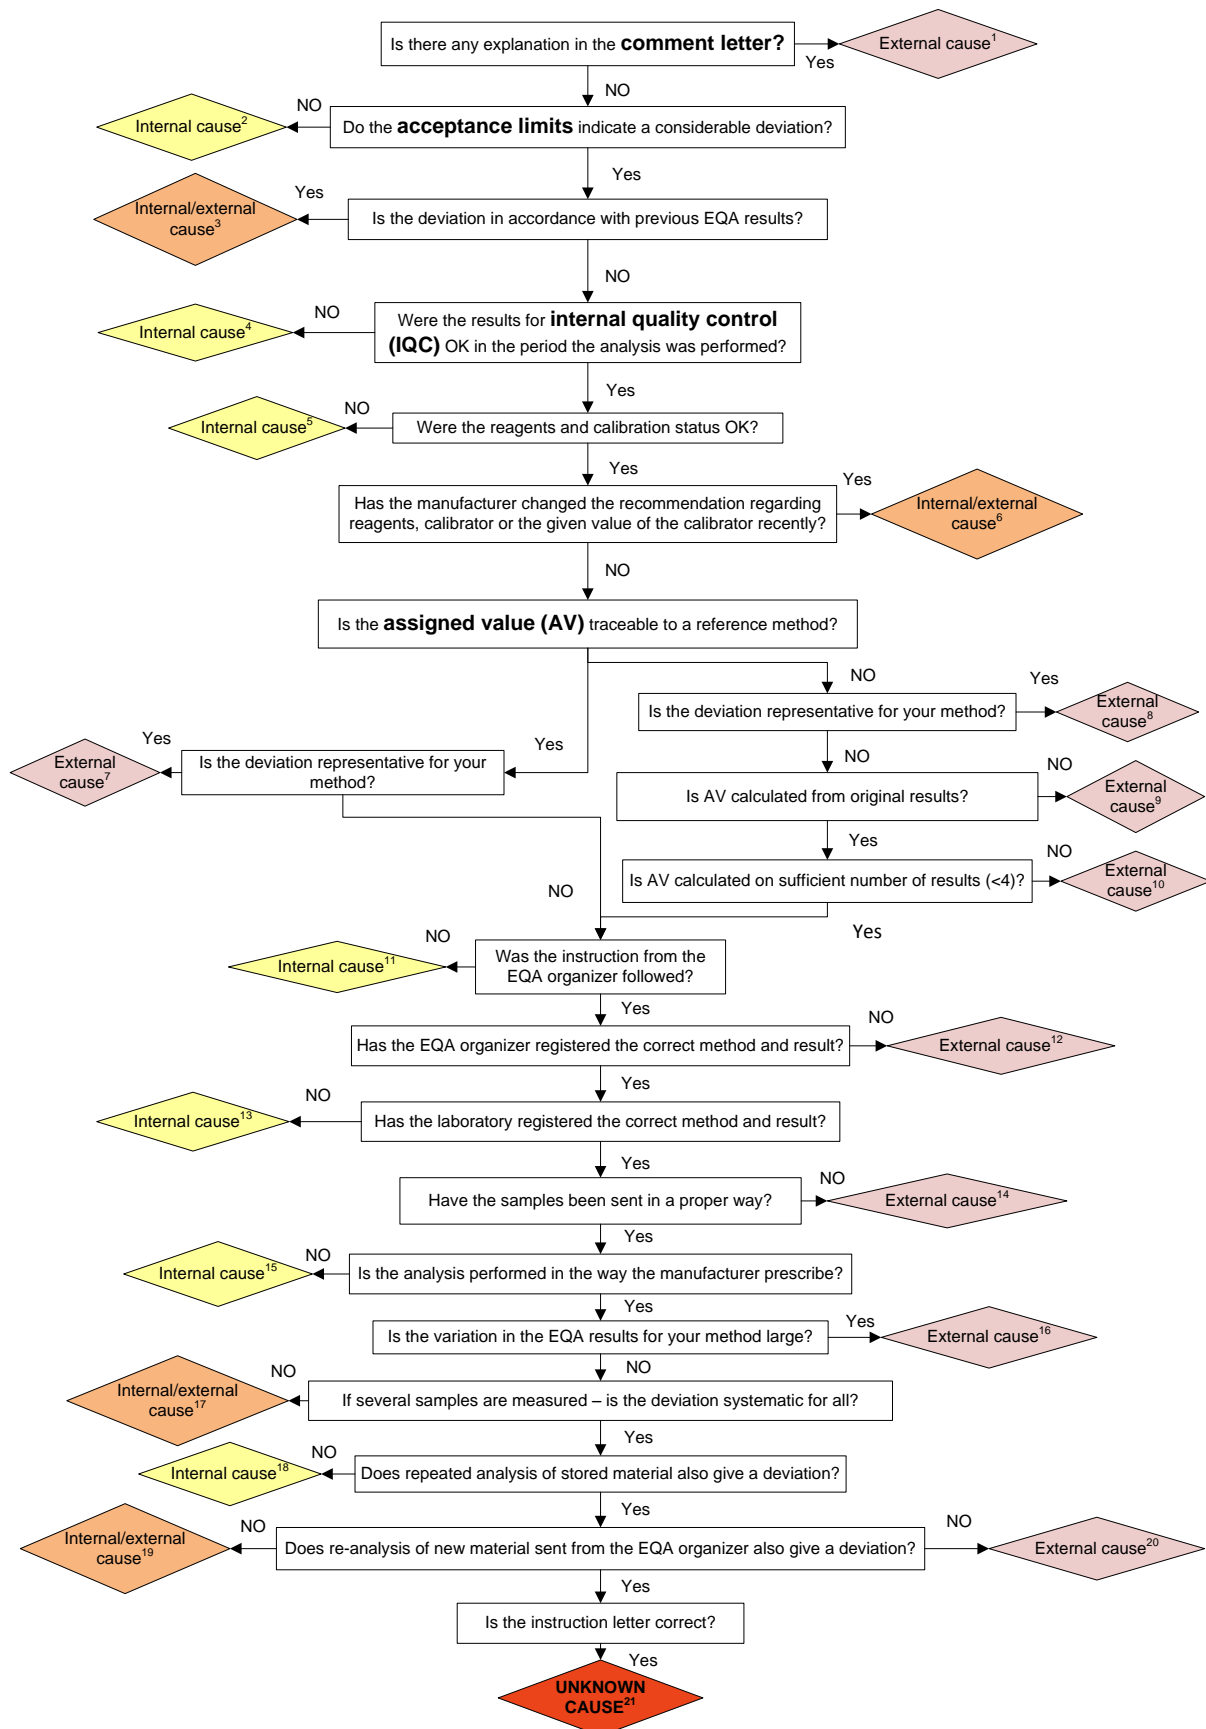

The flowchart consists of several questions indicating possible causes for the deviating result, further explained in the comments corresponding to the footnote numbers, **see attachment**